

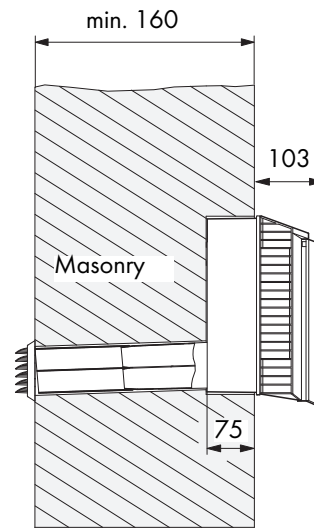
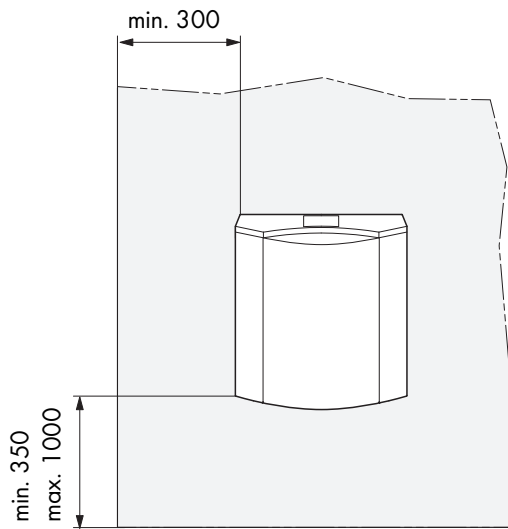


Wall-mounted ventilator with sound absorption and heat recovery

### Installation in the masonry

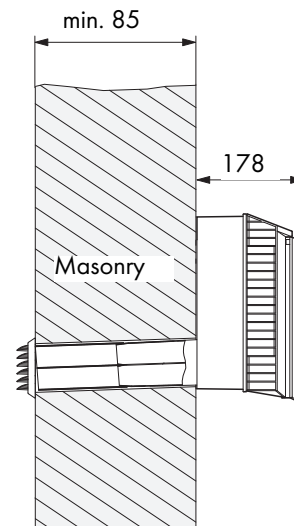

### Mounting to the wall

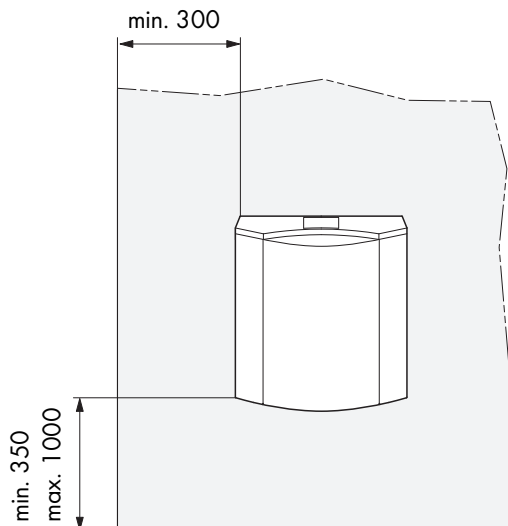

### Recommended installation dimensions

Installation dimensions		Note:
side clearance	min. 300 mm	The minimum clearance must be maintained to avoid impeding the air flow.
Installation height	min. 350 mm max. 1000 mm	The maximum installation height ensures the display can be read easily.
Core drill hole	Ø 120 mm	Wall duct for PVC pipe (outer Ø 110 mm)

Technical specifications and colours are subject to change.

H43.WANSIAU0002EN/0