

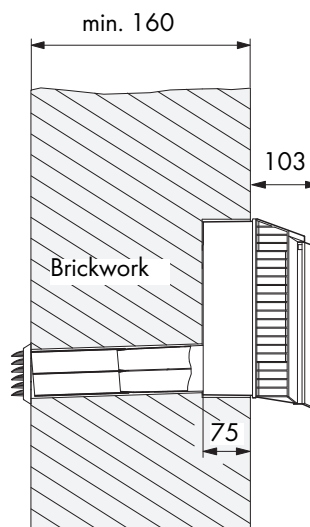
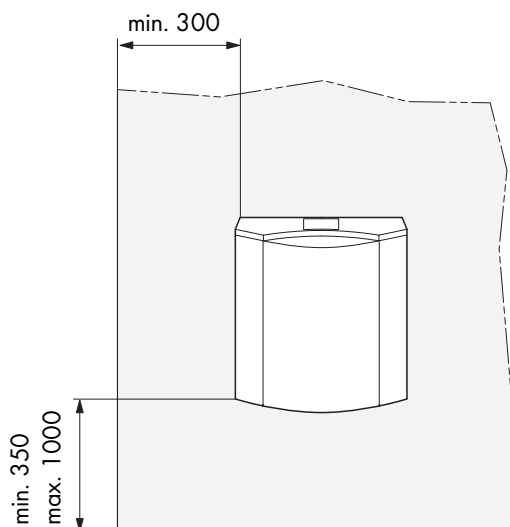


Wall-mounted ventilator with with sound absorption and heat recovery

Installation in the brickwork

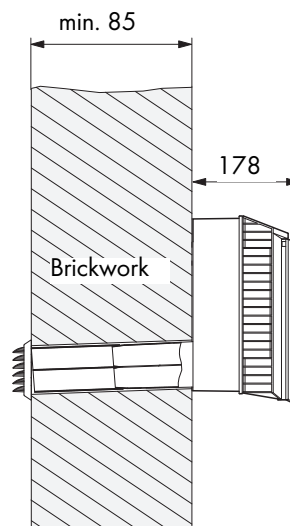

Mounting to the wall

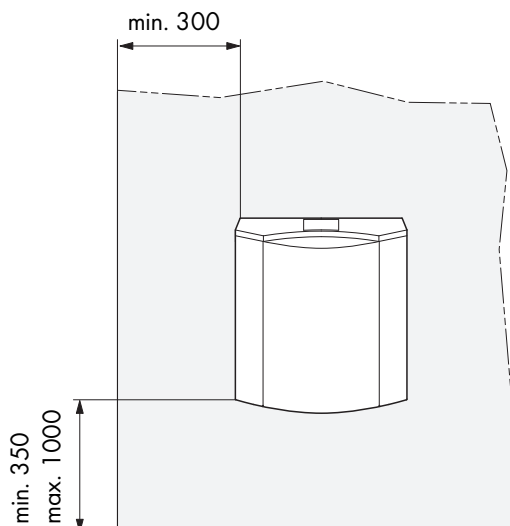

Recommended installation dimensions

Installation dimensions		Note:
side clearance	min. 300 mm	The minimum clearance must be maintained to avoid impeding the air flow.
Installation height	min. 350 mm max. 1000 mm	The maximum installation height ensures the the display can be read.
Core drill	Ø 120 mm	Wall duct for PVC pipe (outer Ø 110 mm)

Technical specifications and colours are subject to change.

H43.WANSIAU0003EN/0